	
	YW-20190404-001
IM267	2019-04-04
	1 15

IM267

IM267

: 135 7383 0623

QQ:1774880258


RV2025

2755

<http://www.jnrovin.com>





	
	YW-20190404-001
IM267	2019-04-04
	5 15

1.6 LED

IM267 LED

		—	
		—	
	0/	—	
	,	,	

2 TIA V15 IM267
IM267 S7-1215C PROFINET CPU
1200 IM267 I/O TIA Portal V15

2.1

IM267

S7-1200CPU

200 222-1PL22 + 222-1HH22 + 232-0HD22 + 231-7PC22

PROFINET

2.2

2.2.1

1 TIA Portal 1200





YW-20190404-001

IM267








YW-20190404-001


IM267

2019-04-04

7 15

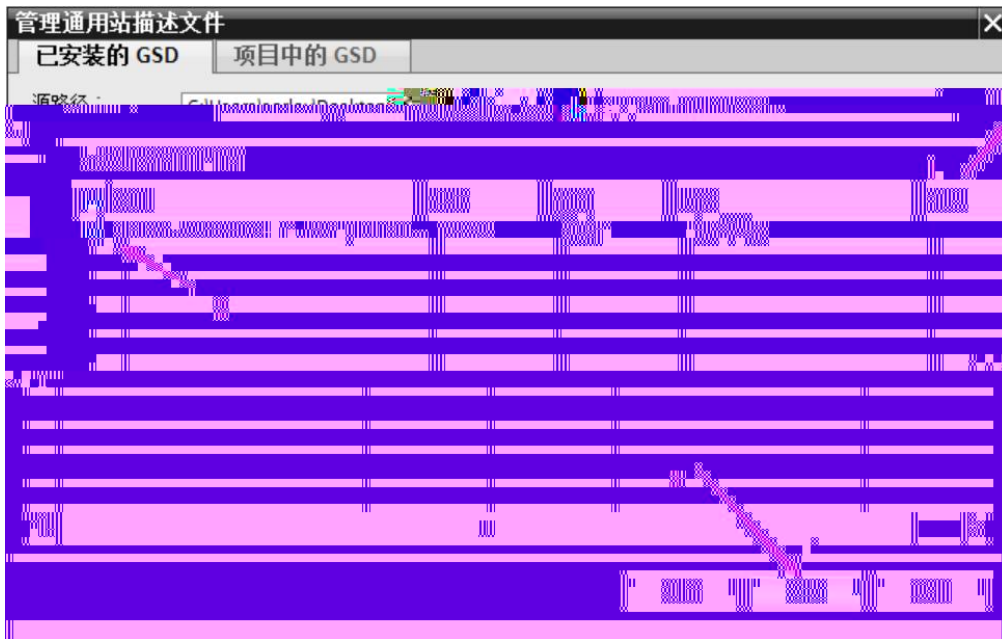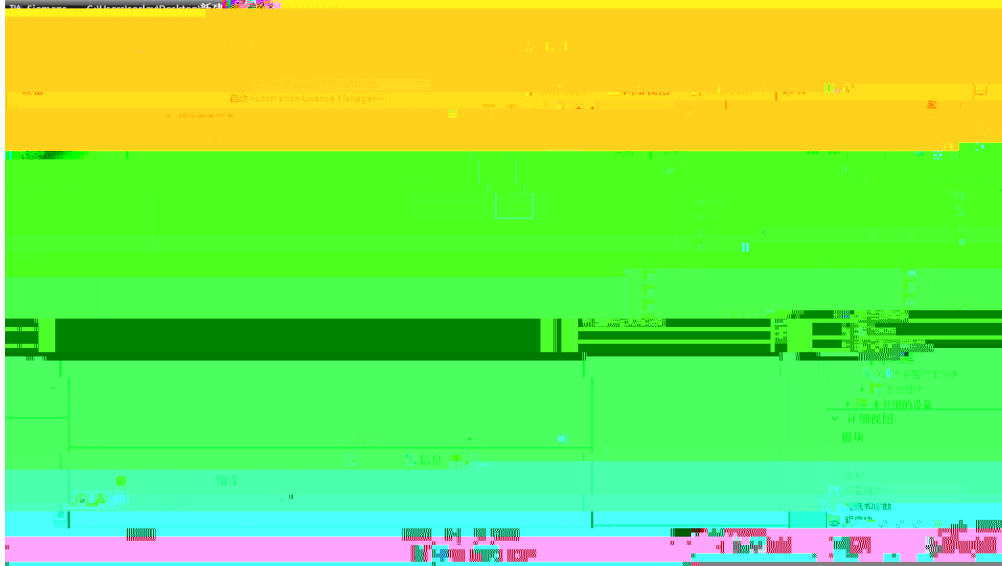

	
	YW-20190404-001
IM267	2019-04-04
	8 15

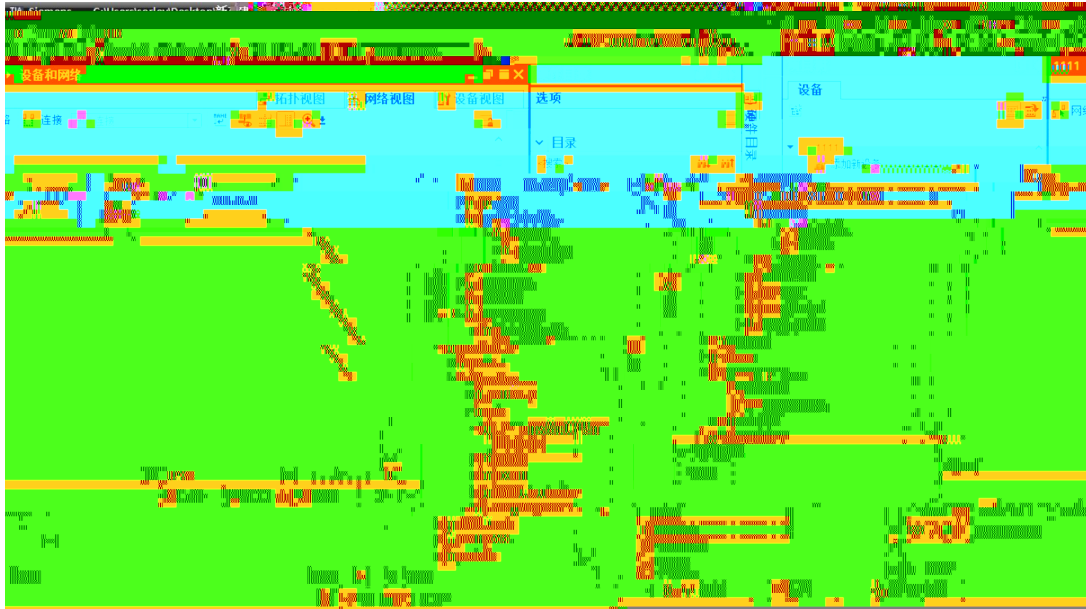


4


PLC IM267

PN/IE_1


IP




	
	YW-20190404-001
IM267	2019-04-04
	9 15

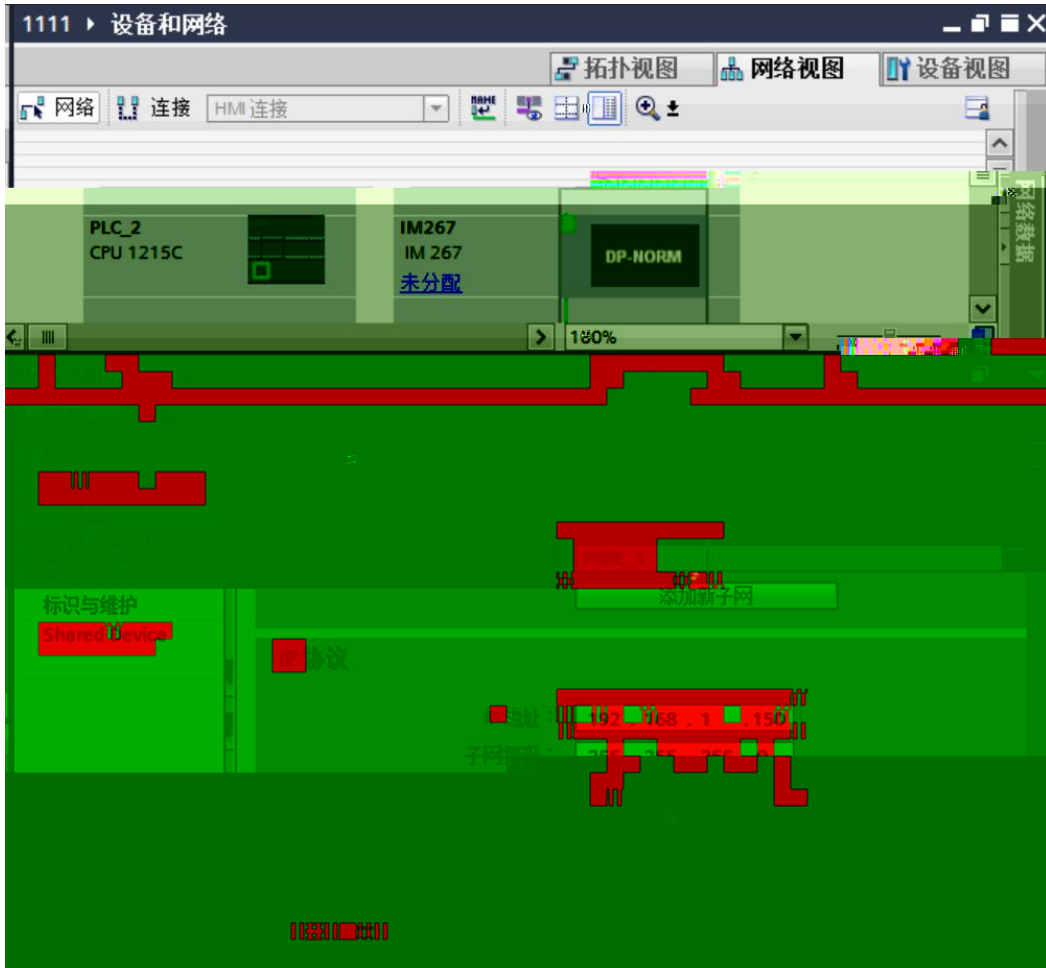

CPU ,

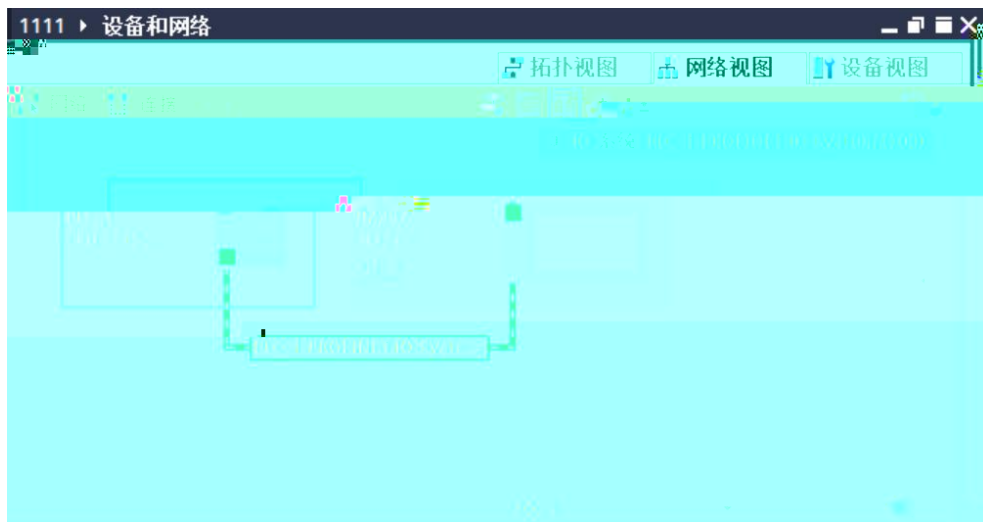

	
	YW-20190404-001
IM267	2019-04-04
	10 15

5



6 IM267

IP

4

267

IP

IP

IM267- -


IM267






j" j ¥ j



	
	YW-20190404-001
IM267	2019-04-04
	12 15

8

CPU

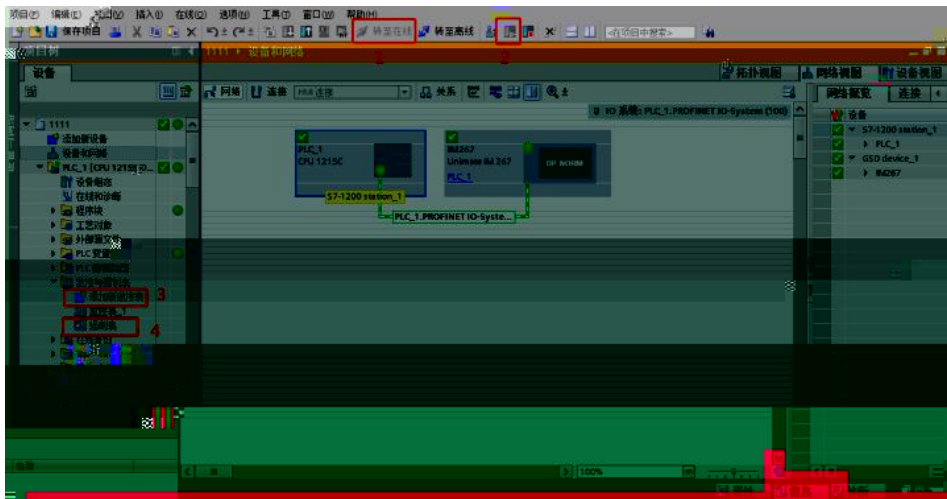

9

QW10,QW14 16000


5V,10mA

IW42

10


200PLC




	
	20190404-001
IM267	9-04-04

B



	
	YW-20190404-001
IM267	2019-04-04
	15 15

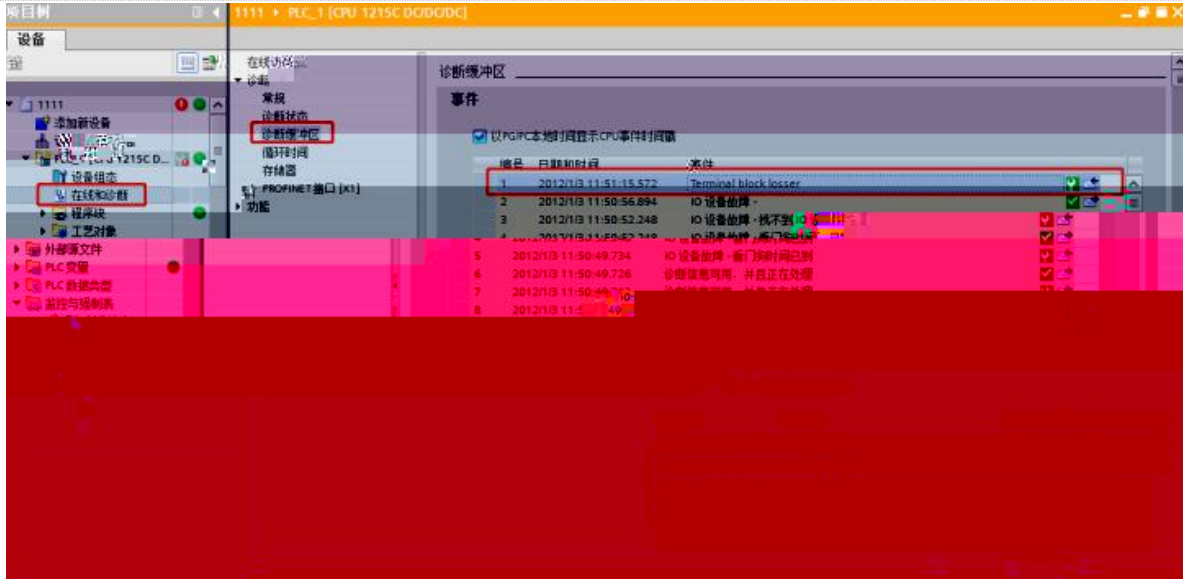

Terminal block loss—

Blown fuse Err—

No user power Err—

Out of-range Err—

Bus Fault or parity err—

Config Mask—

4

IM267

